



# Rokeby Generating Station Saves 50% in Capital Expense by Using 3M™ Liqui-Cel™ EXF-14×28 Series Membrane Contactors to Remove CO<sub>2</sub> to Extend Mixed Bed Resin Life

Lincoln Electric Systems (LES) recently commissioned a membrane decarbonation system using 3M™ Liqui-Cel™ EXF-14×28 Series Membrane Contactors to remove CO<sub>2</sub> prior to their mixed bed deionizers. The system was installed at the Rokeby Generating Station (RGS) in Lincoln, Nebraska.

## Background

The Rokeby Generating Station is LES' primary peaking power station, totaling 255 MW and consisting of 3 dual fuel combustion turbines. The existing DI water system consisted of two single-pass, two-stage RO skids followed by a 31 ft<sup>3</sup> (0.87 m<sup>3</sup>) mixed bed deionizer and two 250,000-gallon (943 m<sup>3</sup>) storage tanks.

LES determined that the mixed bed unit was producing only 30% of its

expected capacity (90,000 gallons actual vs. 300,000 gallons expected or 341 m<sup>3</sup> actual vs. 1136 m<sup>3</sup> expected). It was determined that the cause of the decreased capacity was due to dissolved CO<sub>2</sub> in the water, which was overloading the anion resin. As the power capacity demand increased, LES had to act quickly to update their winter contingency plans.

## Treatment Options


Multiple treatment options including chemical treatment and the installation of a forced draft degasifier were considered. Ultimately, chemical treatment was considered too risky because of its negative impact on increasing scale on the RO membranes. A forced draft deaerator was also considered impractical due to the large capital expense and size constraints at LES.



## System Design

In 2005, LES began engineering a membrane decarbonation system using Liqui-Cel EXF-14×28 series membrane contactors. The system was designed to treat the combined water flow from both RO skids, approximately 150 GPM (0.6 m<sup>3</sup>). The goal was to achieve approximately 90% reduction of dissolved CO<sub>2</sub>.

Figure 1. Decarbonation system incorporating a 3M™ Liqui-Cel™ 14x28 Membrane Contactor

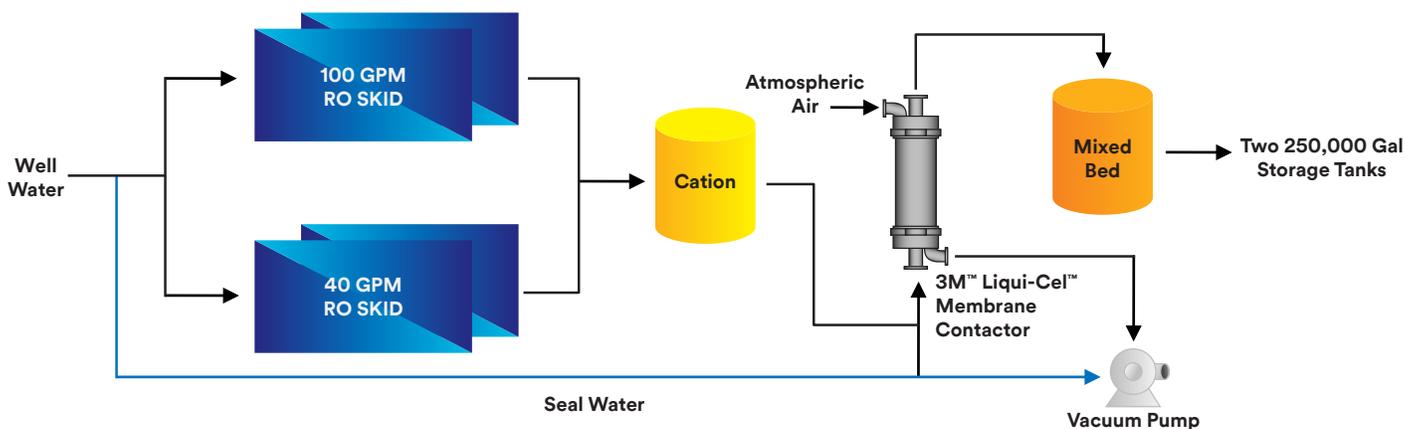

## Technical Brief | Rokeby Generating Station Saves 50% in Capital Expense by Using 3M™ Liqui-Cel™ EXF-14x28 Series Membrane Contactors to Remove CO<sub>2</sub> to Extend Mixed Bed Resin Life

Additionally, the system was designed to operate with vacuum assisted air sweep, using a liquid ring vacuum pump to draw atmospheric air through the 3M™ Liqui-Cel™ Membrane Contactors.

Since the LES staff was able to design, fabricate, and install the Liqui-Cel membrane contactor degassing system, the total capital cost was approximately 50% less than the cost of a forced draft degasifier. The compact design also allowed LES to build the system inside of an existing building with minimal modification. The low system pressure drop through a Liqui-Cel membrane contactor system also eliminated the need for a re-pressurization pump, further lowering operating costs for LES.

The degas skid was installed downstream of the RO skids and before the mixed bed. In order to maximize efficiency, a cation bottle was installed between the RO skids and the degas skid to reduce the pH and convert the HCO<sub>3</sub> to free CO<sub>2</sub> gas. (See Figure 1 on the previous page.)

### Test Set Up

LES temporarily installed three 3.3 ft<sup>3</sup> (0.09 m<sup>3</sup>) mixed bed bottles downstream of the degas skid. The bottles were installed in parallel for a total capacity of 9.9 ft<sup>3</sup> (0.28 m<sup>3</sup>). During the test, only one of the RO units was operated, resulting in water flow of 40 GPM.

LES expected to achieve 138,000 to 168,000 gallons (522 m<sup>3</sup> – 636 m<sup>3</sup>) throughput with this design. They actually achieved 191,000 gallons (725 m<sup>3</sup>). Specific conductivity was 0.5 µS/cm and silica was 7.5 ppb. LES estimates the full-scale capacity will be approximately 617,000 gallons [(32 ft<sup>3</sup> / 9.9 ft<sup>3</sup>) x 191,000 = 617,374 gallons (2337 m<sup>3</sup>)]. This represents an increase in the total capacity of the system by a factor of 5.9.

### Summary

Liqui-Cel membrane contactors offer a cost-effective, efficient option for removal of CO<sub>2</sub> from process water. Removal of CO<sub>2</sub> prior to the mixed bed resins significantly improves regeneration times, thereby reducing operating costs and improving overall efficiency by minimizing downtime.

For more information and system sizing, please contact your 3M representative or visit [3M.com/Liqui-Cel](http://3M.com/Liqui-Cel).

**Technical Information:** The technical information, recommendations and other statements contained in this document are based upon tests or experience that 3M believes are reliable, but the accuracy or completeness of such information is not guaranteed.

**Product Use:** Many factors beyond 3M's control and uniquely within user's knowledge and control can affect the use and performance of a 3M product in a particular application. Given the variety of factors that can affect the use and performance of a 3M product, user is solely responsible for evaluating the 3M product and determining whether it is fit for a particular purpose and suitable for user's method of application.

**Warranty, Limited Remedy, and Disclaimer:** Unless an additional warranty is specifically stated on the applicable 3M product packaging or product literature, 3M warrants that each 3M product meets the applicable 3M product specification at the time 3M ships the product. 3M MAKES NO OTHER WARRANTIES OR CONDITIONS, EXPRESS OR IMPLIED, INCLUDING, BUT NOT LIMITED TO, ANY IMPLIED WARRANTY OR CONDITION OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE OR ANY IMPLIED WARRANTY OR CONDITION ARISING OUT OF A COURSE OF DEALING, CUSTOM OR USAGE OF TRADE. If the 3M product does not conform to this warranty, then the sole and exclusive remedy is, at 3M's option, replacement of the 3M product or refund of the purchase price.

**Limitation of Liability:** Except where prohibited by law, 3M will not be liable for any loss or damage arising from the 3M product, whether direct, indirect, special, incidental or consequential, regardless of the legal theory asserted, including warranty, contract, negligence or strict liability.

3M and Liqui-Cel are trademarks of 3M Company. All other trademarks are the property of their respective owners. © 2017 3M Company. All rights reserved.



Separation and Purification  
Sciences Division  
13840 South Lakes Drive  
Charlotte, North Carolina  
28273 USA  
Phone: +1 980 859 5400

3M Deutschland GmbH  
Separation and Purification  
Sciences Division  
Öhder Straße 28  
42289 Wuppertal Germany  
Phone: +49 202 6099 - 0  
Fax: +49 202 6099 - 241



ISO 9001

LC-1070  
Rev. 03/2017

[3M.com/Liqui-Cel](http://3M.com/Liqui-Cel)