



# Start-up Procedures

## for 3M™ Liqui-Cel™ SP 1×3, 1×6 and 2×6 Series Membrane Contactors

**Prior to any start-up procedure, proper installation is required.**

Please read and follow all safety information, warnings and instructions in this manual. Failure to follow all product warnings and instructions could cause serious injury and property damage. Retain these instructions for future reference.

### **Intended Use and Product Selection:**

3M™ Liqui-Cel™ Membrane Contactors are intended to remove dissolved gasses and bubbles from compatible liquids or to add gasses to a liquid stream. Liqui-Cel products are for use in industrial separation applications of industrial fluids only, in accordance with the applicable product instructions and specifications. Certain limited Liqui-Cel products are also intended for use in specific Food and Beverage (F&B) applications when used in accordance with product use requirements and instructions. Refer to the specific Liqui-Cel product's performance data sheet to determine whether it includes a F&B designation and can be used for such applications.

3M™ Liqui-Cel™ SP 1×3 Series Membrane Contactors are not constructed of US FDA Title 21 CFR § 174-186 compliant materials. Not for use in food contact applications. 3M™ Liqui-Cel™ SP-1×6 and 2×6 Series Membrane Contactors are constructed of FDA Title 21 CFR § 174-186 compliant materials for wetted parts only at ambient temperatures.

Since there are many factors that can affect a product's use, the customer and user remains responsible for determining whether the 3M product is suitable and appropriate for the user's specific application, including user conducting an appropriate risk assessment and evaluating the 3M product in user's application.

### **Restrictions on Use:**


3M advises against the use of these 3M products in any application other than the stated intended use(s), since other applications have not been evaluated by 3M and may result in an unsafe or unintended condition. Do not use in any manner whereby the 3M product, or any extractable or leachable from the 3M product, may become part of or remains in a medical device, drug, cosmetic, or supplement, infant formula; or in applications involving life-sustaining medical applications or prolonged contact with internal bodily fluids or tissues.

## Steps:

1. Mount the membrane contactor vertically or horizontally. Vertical orientation is recommended where possible.
2. These membrane contactors operate in vacuum only mode. The start-up procedure is the same for all products. The proper liquid and vacuum port connections must be made as illustrated below.

## Correct Mounting Position and Port Identification

### Vertically Mounted Module

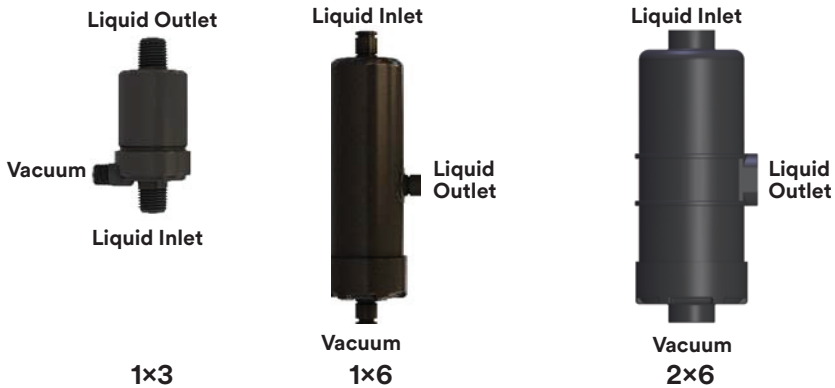

(Other connection options may be available. Refer to product datasheets.)

### Start-up Procedures

#### A. General start-up instructions for the liquid phase.

**Note:** The gas/vacuum port should not be closed off during operation

1. Connect the liquid inlet/outlet ports and the vacuum port as shown in the illustrations above. For 1x6 and 2x6, either liquid port can be used for the inlet.
2. Slowly introduce liquid into the contactor, making sure that the liquid inlet pressure and liquid flow rate through the contactor never exceed the respective maximum operating limits: The liquid must flow on the shell side of a 3M™ Liqui-Cel™ SP Series Membrane Contactor.
3. Adjust the liquid flow rate and inlet pressure to the desired levels by adjusting the appropriate valves on the system.

#### B. Vacuum


1. Start vacuum pump following the vacuum pump manufacturer's instructions.
2. Apply vacuum to the contactor by opening appropriate valve.
3. Adjust absolute gas pressure on the vacuum side to the desired level at the vacuum port on the contactor (absolute pressure depends on gauge vacuum as well as barometric pressure).

## Start-up Procedures | 3M™ Liqui-Cel™ SP 1×3, 1×6 and 2×6 Series Membrane Contactors

### Notes:

- Use of metal connectors is not recommended.
- Prefiltration is recommended. Filtration requirements depend on operating conditions and the nature of the liquid introduced to the contactor. Contact your 3M representative for guidance.
- The liquid pressure should always be higher than the gas pressure inside the contactor.
- Liquid must flow on the shell side (outside) of the fiber.
- The vacuum port should not be closed off during operation. Never connect liquid or gas under pressure to the vacuum port as it may damage the membrane contactor.

### Horizontally Mounted Module

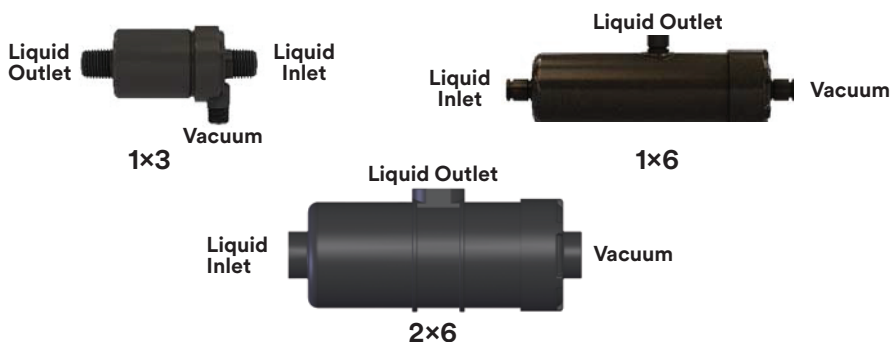

Product	Maximum Pressure*	Maximum Flow Rate
1×3	5-25°C, 3.1 barg (41-77°F, 45 psig) 40°C, 1.0 barg (104°F, 15 psig)	60 ml/min
1×6	5-25°C, 4.1 barg (41-77°F, 60 psig) 75°C, 1.0 barg (167°F, 15 psig)	300 ml/min
2×6	5-25°C, 7.2 barg (41-77°F, 105 psig) 75°C, 1.0 barg (167°F, 15 psig)	2000 ml/min

\* using 50 torr (mm Hg) vacuum on lumen side.

### Guideline for Minimum Vacuum Pressure

Maintain a vacuum level such that the absolute pressure on the vacuum side (lumen side) of the membrane is higher than the vapor pressure of the most volatile component in the liquid (water or solvent, etc.) at the operating temperature.

For example, the vapor pressure of a water-based ink operating at a temperature of 25°C would be approximately 20-22 torr (mm Hg) absolute. In this case, the absolute pressure on the vacuum side should be approximately 25-30 torr or higher. Typically, pulling a vacuum deeper than 30 torr is NOT recommended.

## SAFETY INFORMATION:

Explanation of Signal Word Consequences	
<b>⚠ WARNING</b>	Indicates a hazardous situation which, if not avoided, could result in serious injury or death.
<b>NOTICE</b>	Indicates a situation which, if not avoided, could result in product or system damage.

Read entire product manual. Failure to follow all product instructions and warnings could cause personal injury and/or property damage.

**⚠ WARNING – To reduce the risks associated with liquid bursting or gas explosion and/or exposure to chemicals and membrane contactor damage:**

- To prevent buildup of pressure inside the membrane contactor, do not block or valve off all gas/vacuum ports during operation or downtime.
- Do not exceed maximum operating pressure or temperature limits. Cleaning should be conducted at the minimal temperature and pressure required to clean the contactor, never exceeding the maximum operating pressure and temperature limits of the contactor.
- Implement workplace safety risk controls according to local applicable laws and regulations.
- Always use appropriate personal protective equipment (PPE) when installing, servicing, operating, cleaning or disposing of the membrane contactor.

**To reduce the risks associated with fire and explosion:**

- Do not introduce explosive, flammable, toxic or oxidizing liquids or gases in dangerous concentrations into the membrane contactor or the system.

**NOTICE – To reduce membrane contactor or system damage:**

- Care must be taken not to drop, hit or impact the membrane contactor.
- If the membrane contactor is used with air sweep, then the temperature should not exceed 35°C (95°F). For membrane contactors used with vacuum only this statement does not apply.
- To avoid contamination of the process fluid, gloves are recommended when handling the membrane contactors.
- 3M Liqui-Cel Membrane Contactors should be stored dry and in a sealed plastic bag or shrink wrap material to help prevent the introduction of contaminants into the membrane contactor.
- 3M Liqui-Cel Membrane Contactors should be stored in their original box, or other opaque box, and should not be installed where they are exposed to direct sunlight.
- Store 3M Liqui-Cel Membrane Contactors dry at temperatures <50°C (122°F), but preferably at lower temperature such as <35°C (95°F), to not risk reduced lifetime. Membrane contactors should always be stored above freezing temperatures, and if stored at low temperature, they should be allowed to equilibrate to room temperature before use.
- Do not allow membrane contactors containing microporous hollow fiber membranes to come into contact with surfactants, oil, or organic solvents, such as pure alcohols, glycol, acetone, etc., to reduce the risk of membrane wet out. SP-series membrane contactors containing polyolefin membrane are not subject to this restriction.
- Filtered, de-chlorinated, and deionized water is recommended for mixing cleaning solutions. If a pH shift occurs, water containing sparingly soluble compounds of Ca, Mg, Fe, Al, and silica (SiO<sub>2</sub>) etc. could precipitate from the solution and block or damage the membrane. Ensure that your water is free of these compounds.
- Cumulative exposure of the membrane to oxidants, such as ozone, chlorine, hydrogen peroxide, peracetic acid, etc., should be restricted to reduce the risk of membrane oxidation.

### ATTENTION:

#### Disposal

At end of life, dispose of the membrane contactor or cartridges in accordance with all applicable local and government regulations.

#### Hazards from Chemicals

The chemicals that User selects to use in connection with the membrane can present their own hazards. User should follow all safety information and related requirements provided by the chemical supplier and applicable regulations, as well as conduct User's own workplace safety, hazard and application assessment. This document cannot and does not address all safety and/or safe handling requirements that different chemicals could present. User is responsible for ensuring that chemicals are only used by persons familiar with their use and hazards (for example, personnel who have received hazardous material training), and who have the appropriate protective equipment as specified in their organization's safety program and the chemical's safety datasheet (SDS). User assumes all responsibility for the suitability and fitness for use as well as for the protection of the environment and for health and safety involving such chemicals.

**Product Selection and Use:** Many factors beyond 3M's control and uniquely within user's knowledge and control can affect the use and performance of a 3M product in a particular application. As a result, customer is solely responsible for evaluating the product and determining whether it is appropriate and suitable for customer's application, including conducting a workplace hazard assessment and reviewing all applicable regulations and standards (e.g., OSHA, ANSI, etc.). Failure to properly evaluate, select, and use a 3M product and appropriate safety products, or to meet all applicable safety regulations, may result in injury, sickness, death, and/or harm to property.

**Warranty, Limited Remedy, and Disclaimer:** Unless a different warranty is specifically stated on the applicable 3M product packaging or product literature (in which case such warranty governs), 3M warrants that each 3M product meets the applicable 3M product specification at the time 3M ships the product. 3M MAKES NO OTHER WARRANTIES OR CONDITIONS, EXPRESS OR IMPLIED, INCLUDING, BUT NOT LIMITED TO, ANY IMPLIED WARRANTY OR CONDITION OF MERCHANTABILITY, FITNESS FOR A PARTICULAR PURPOSE, OR ARISING OUT OF A COURSE OF DEALING, CUSTOM, OR USAGE OF TRADE. If a 3M product does not conform to this warranty, then the sole and exclusive remedy is, at 3M's option, replacement of the 3M product or refund of the purchase price.

**Limitation of Liability:** Except for the limited remedy stated above, and except to the extent prohibited by law, 3M will not be liable for any loss or damage arising from or related to the 3M product, whether direct, indirect, special, incidental, or consequential (including, but not limited to, lost profits or business opportunity), regardless of the legal or equitable theory asserted, including, but not limited to, warranty, contract, negligence, or strict liability.

3M and Liqui-Cel are trademarks of 3M Company. All other trademarks are the property of their respective owners.

© 2022 3M Company. All rights reserved



3M Company  
3M Separation and Purification  
Sciences Division  
13840 South Lakes Drive  
Charlotte, North Carolina 28273 USA  
Phone: +1 980 859 5400

3M Deutschland GmbH  
3M Separation and Purification  
Sciences Division  
Oder Straße 28  
42289 Wuppertal Germany  
Phone: +49 202 6099 - 0

LC-1024  
Rev 03/2022  
34-8728-3911-2

[3M.com/Liqui-Cel](https://www.3m.com/Liqui-Cel)