


CAUTION: CHECK THE INSULATION DIAMETER. THE DIAMETER MUST BE BETWEEN 1.320 & 1.520 INCHES.

A. PREPARE CABLES ACCORDING TO STANDARD PROCEDURES (FIGURE 1)

1. Allow sufficient concentric neutral wires for connection.
2. Gently fold neutral wires back over cable jackets. Avoid sharp bends.
3. Continue preparation of cables according to Figures 1 & 2.

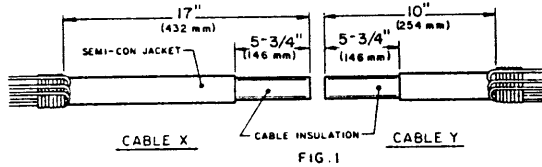

5. Install splice body onto cable X.



FIG. 3

6. Install connector. See connector and crimping tool table below.
7. Reclean and lubricant exposed insulation.
8. Center splice body over connector as in Figure 4.




FIG. 4

4. Clean cables.
 - a. Do not use solvent on semi-conductive jacket.
 - b. Do not use abrasive cloth on insulation or semi-con jacket.

B. INSTALLATION PROCEDURES (FIGURES 2,3 and 4)

1. In order to facilitate splice installation wrap a small amount of vinyl tape around the edge of the jacket on cable X to form a ramp. This tape must be removed after step 8.
2. Lubricate the insulation of both cables with silicone grease furnished in kit.
3. Slide end caps onto their respective cables.
4. Clean and generously relubricate insulation of cable X.

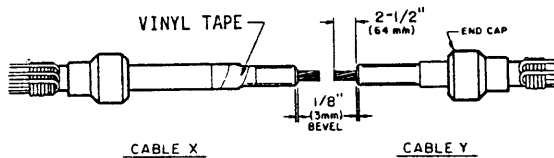


FIG. 2

9. Apply silicone grease over exposed insulation.
10. Firmly seat one end cap against splice body and twist onto splice body. Two locking grooves exist on the splice body. THE WORKMAN SHOULD FEEL TWO SNAPS.
11. Check for proper spacing between splice body and jacket of other cable.
12. Firmly seat remaining end cap against splice body.

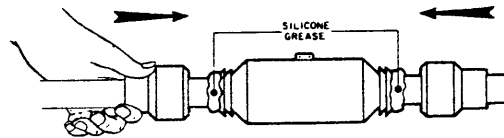


FIG. 5

C. GROUNDING THE SPLICE

1. Attach one wire from each cable to the grounding eye and remainder to an inline connector as shown.

3M Systems for Splicing and Terminating.

REDUCED COPY

CONNECTOR TABLE

CONDUCTOR SIZE	3M SPLICE CONNECTOR NUMBER
750 MCM	CI-750
750 MCM COMPACT	CI-650

NOTE: A SPECIAL 3M "CI" SERIES CONNECTOR IS NECESSARY FOR USE IN ALL QUICK SPLICES

CRIMPING TOOL TABLE

CABLE SIZE	MFG.	HYDRAULIC	
		TOOL	DIE (CRIMPS PER END)
750MCM	BURNDY	Y-39	U39 ART-2(3)
		Y-45	S39 ART (3)
	KEARNEY	WH-2	I-1/2 (3)
		T & B	TBM-15

* - USABLE WITH U-DIE ADAPTER PT651
 ** - EXCESS FLASH MUST BE FILED OFF TO ROUND OUT CONNECTOR

TECHNICAL DATA
 VOLTAGE RATING 15KV
 FOR CABLES RATED 90°C COND. TEMP.
 AL. OR CU. POND.
 PASSES TESTS REQUIRED IN IEEE PROPOSED STANDARD FOR POWER CABLE JOINTS

IMPORTANT NOTICE TO PURCHASER: All statements, technical information and recommendations contained herein are based on tests we believe to be reliable, but the accuracy or completeness thereof is not guaranteed, and the following is made in lieu of all warranties, express or implied:

Seller's and manufacturer's only obligation shall be to replace such quantity of the product proved to be defective. Neither seller nor manufacturer shall be liable for any injury, loss or damage, direct or consequential, arising out of the use of or the inability to use the product. Before using, user shall determine the suitability of the product for his intended use, and user assumes all risk and liability whatsoever in connection therewith.

No statement or recommendation not contained herein shall have any force or effect unless in an agreement signed by officers of seller and manufacturer.

ISSUE 7	DATE 8 JUNE 77	REV.	CH.
NOT TO SCALE		CH	
DR. N.E. WROBEL	APP. <i>[Signature]</i>		
2047 T 8			
Electro-Products Division 3M			

3M QUICK-SPLICE

INLINE SPLICING KIT

5408

FOR USE ON CONCENTRIC NEUTRAL (URD) CABLE

CONDUCTOR SIZE 750 MCM

INSULATION O.D. 1.320" (33.53 mm) TO 1.520" (38.61 mm)