

# 3M™ Cold Shrink QS4 Integrated Splice Kit QS4-35SP-1/0-350

for Jacketed Concentric Neutral (JCN), Flat Strap, Tape Shield and Longitudinally Corrugated (LC) Cable

## Instructions

IEEE Std. 404  
35 kV Class  
250 kV BIL

### CAUTION

Working around energized systems may cause serious injury or death. Installation should be performed by personnel familiar with good safety practice in handling electrical equipment. De-energize and ground all electrical systems before installing product.

Kit Selection Table

Kit Number	Cable Insulation O.D. Range	Min. Cable Jacket O.D.	Conductor Size Range
QS4-35SP-1/0-350	1.07"–1.70" (27,2–43,2 mm)	1.51" (38,4 mm)	1/0 AWG-350 kcmil* (60-185 mm <sup>2</sup> )

\*Splices (including size transitions) can be made to smaller or larger conductors (but larger conductors may require special neutral handling), provided both cables are within the Insulation O.D. Range and the connector meets the dimensional requirements shown below.

Connector Dimensional Requirements

	Minimum Inches (mm)	Maximum Inches (mm)
Outside Diameter	0.51" (13,0 mm)	1.70" (43,2 mm)
Length Aluminum (Al/Cu) Compression	—	6.00" (152 mm)
Length Copper (Cu) Compression and 3M™ Shearbolt Connector QCI 1/0-350	—	6.50" (165 mm)

## **1.0 Kit Contents**

- a. 3M Cold Shrink QS4 Integrated Splice Body QS4-35SP-1/0-350 (1 ea.)
- b. Constant Force Springs (4 ea.)
- c. 3M Red Compound P55/R Tubes (non-silicone grease) (2 ea.)
- d. Scotch® Rubber Mastic Tape 2228 Rolls, 2" x 36" (2 ea.)
- e. Scotch® Mastic Strips 2230, 6" length (9 ea.)
- f. Cold Shrink Adapter Tubes (2 ea.)
- g. 3M EMI Copper Foil Shielding Tape 1181 Strips, 1/2" x 10" (2 ea.)
- h. Scotch® Electrical Shielding Tape 24, 1" x 15' (1 ea)
- i. 3M Aluminum Foil Tape Strips 1115B, 10" length (2 ea)
- j. 3M Cable Cleaning Pads CC-3 (1 ea.)
- k. Cut-back Template (1 ea.)
- l. Wire Brush (1 ea.)
- m. Instruction Booklet (1 ea.)

***Note:*** *Cold Shrink adapter tubes may not be included in all kits.*

***Note:*** *Do not use knives to open plastic bags.*

***Note:*** *Connector not shown, but if included, it is indicated on the packaging label.*

## 2.0 Prepare Cables

- 2.1 Check to be sure the cable fits within the kit ranges as shown on the cover page.
- 2.2 Prepare cables according to standard procedures. Refer to template provided or illustration below for proper dimensions (*Figure 1*).

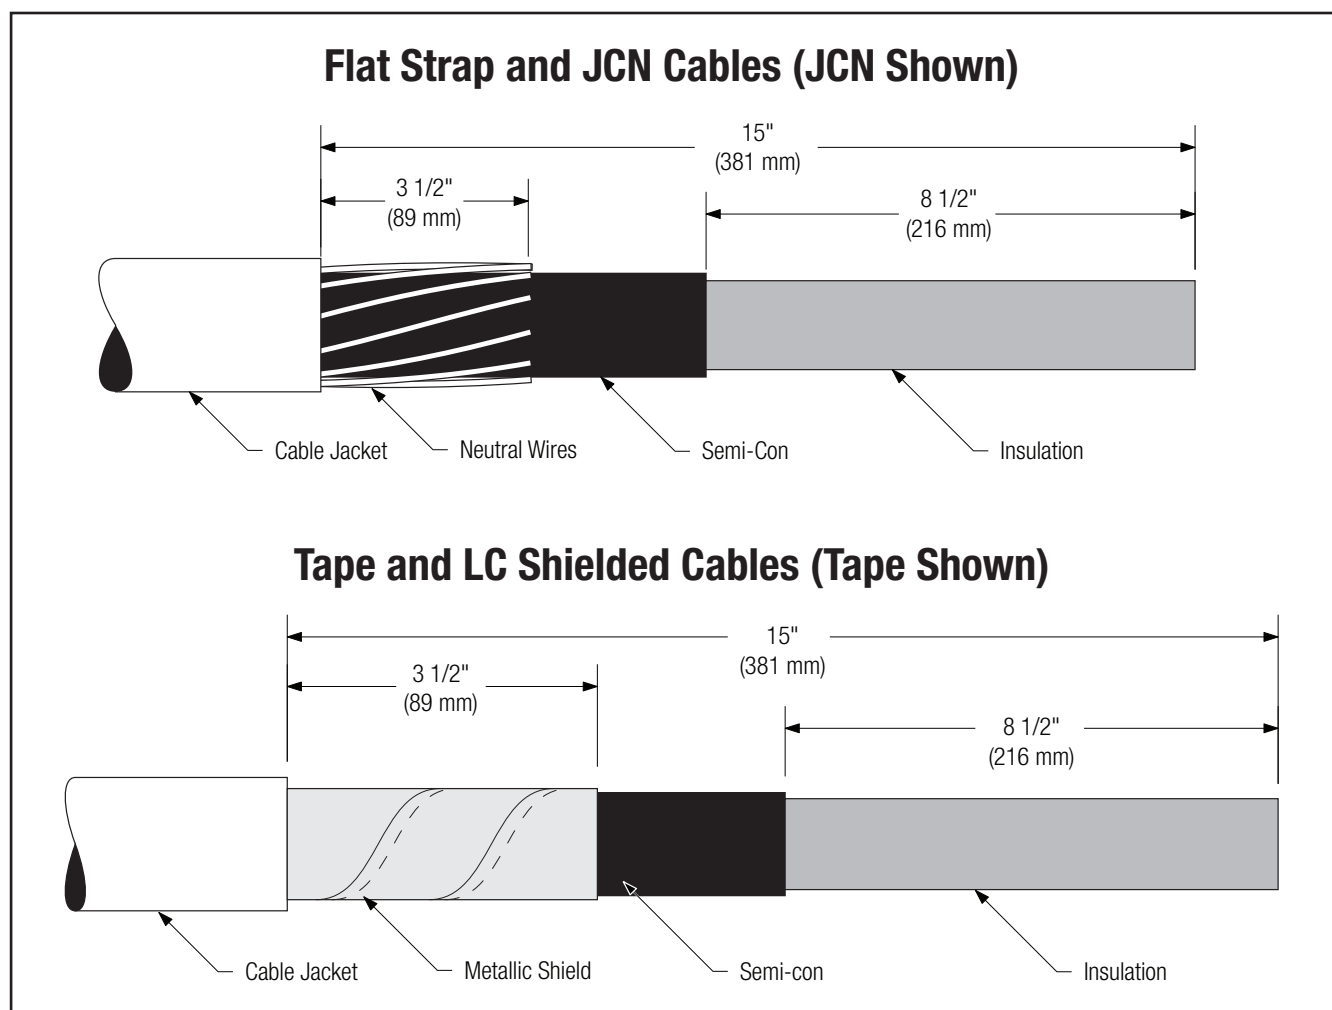


Figure 1

- 2.3 **If using Tape or LC Shielded Cable:** Secure end of each metallic shield with a copper tape strip. Go to Step 2.9.

- 2.4 If using JCN or Flat Strap Cable:** Carefully bend the cut neutral wires up and away from the cable semi-con as shown. Fold one Scotch® Mastic Strip 2230 in half lengthwise and apply one wrap only at cable jacket edge under the neutral wires (*Figure 2*).

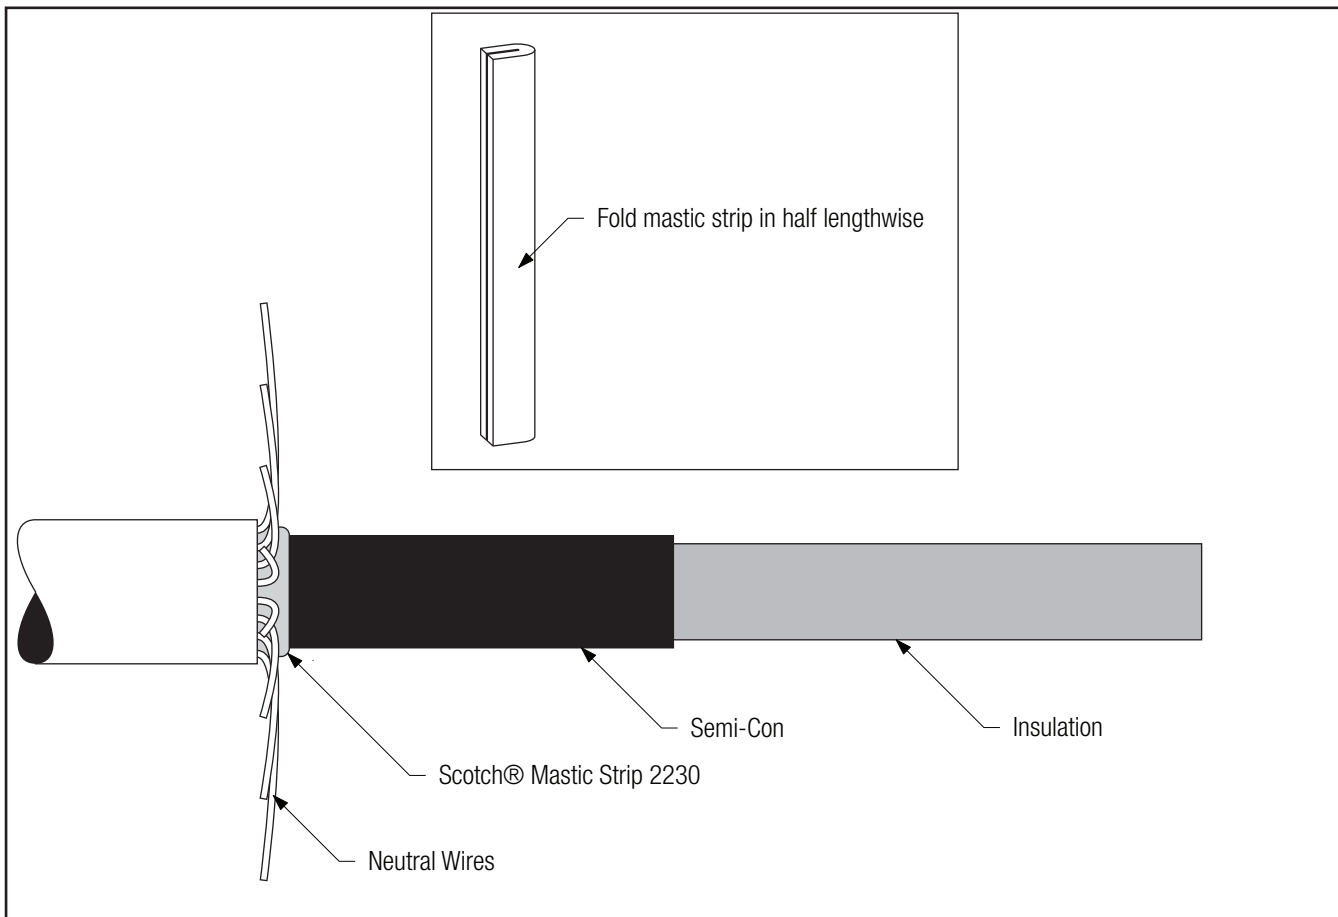


Figure 2

- 2.5 If using JCN or Flat Strap Cable:** Mark the cable semi-con 4" (102 mm) from the cable jacket edge. Apply two half-lapped layers of Scotch® Electrical Shielding Tape 24 over the cable semi-con, starting from the mastic edge out to the mark on the semi-con and back. Half-hitch to tie off (*Figure 3*).

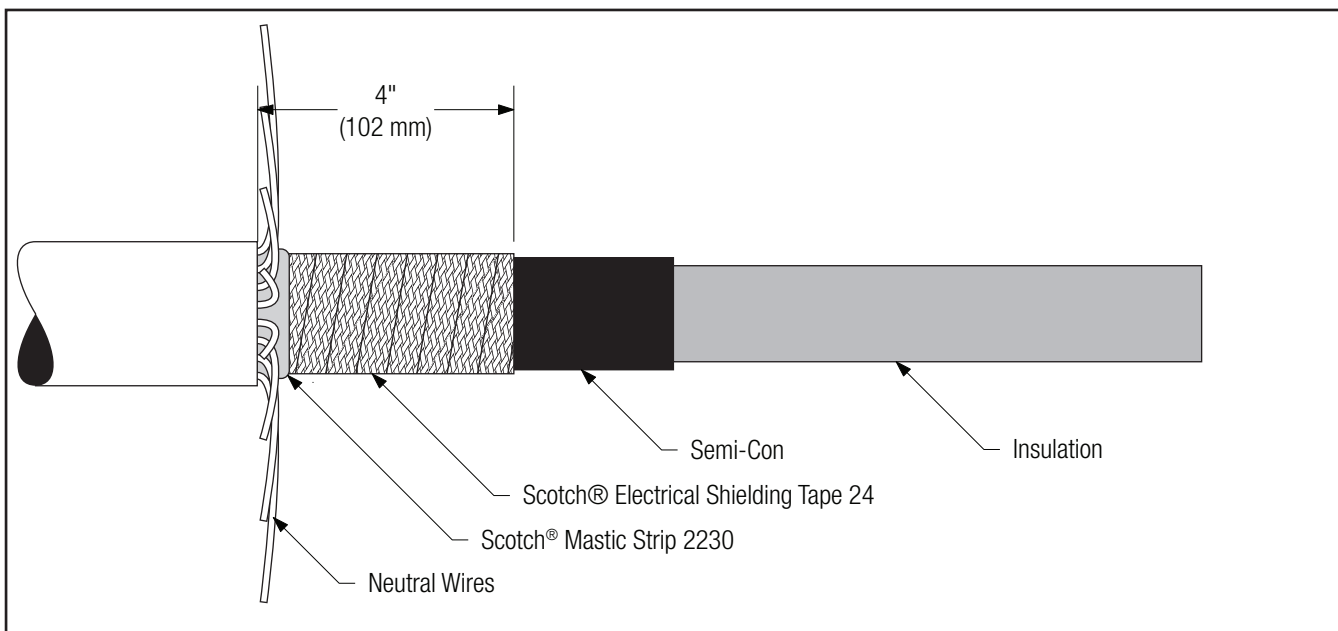


Figure 3

## 3M™ Cold Shrink QS4 Integrated Splice Kit QS4-35SP-1/0-350

- 2.6 If using JCN or Flat Strap Cable:** Carefully lay neutral wires back down on top of the shielding tape and press into mastic. Keep wire profile low by following the concentric turn in the cable (*Figure 4*).
- 2.7 If using JCN or Flat Strap Cable:** Remove the liner from one 3M Aluminum Foil Tape Strip 1115B and secure the ends of the neutral wires. Wrap the aluminum tape on top of itself and tightly press down on the edge of the tape toward the end of the electrical shielding tape (*Figure 4*). If preferred, 2 wraps of vinyl tape may be used to temporarily secure the ends of the neutral wires instead of the aluminum tape.

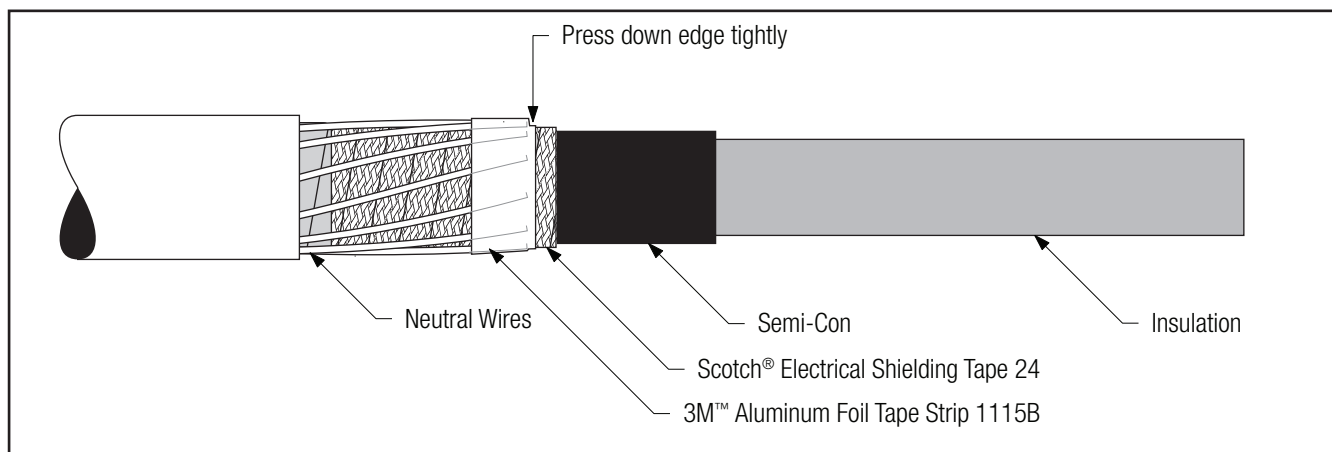


Figure 4

- 2.8 If using JCN or Flat Strap Cable:** Apply a Scotch® Mastic Strip 2230 over the previously applied mastic strip and overlapping onto the cable jacket. Knead mastic around neutral wires. Overwrap mastic with vinyl tape, taking care not to extend tape along neutral wires (*Figure 5*).

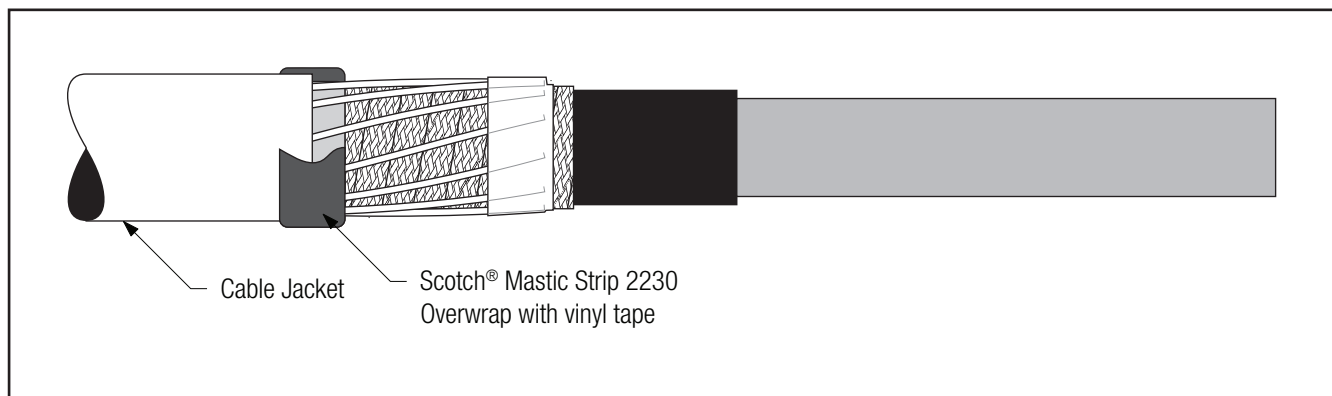


Figure 5

## 3M™ Cold Shrink QS4 Integrated Splice Kit QS4-35SP-1/0-350

- 2.9 Clean or cover cable jacket 30" (760 mm) from jacket edge on side where splice body will be parked.
- 2.10 Slide integrated splice body onto clean cable jacket, ensuring that the long ground strap is on the side of the splice where the external grounding will be located (*Figure 6*). The ground strap may or may not be covered with heat shrink.

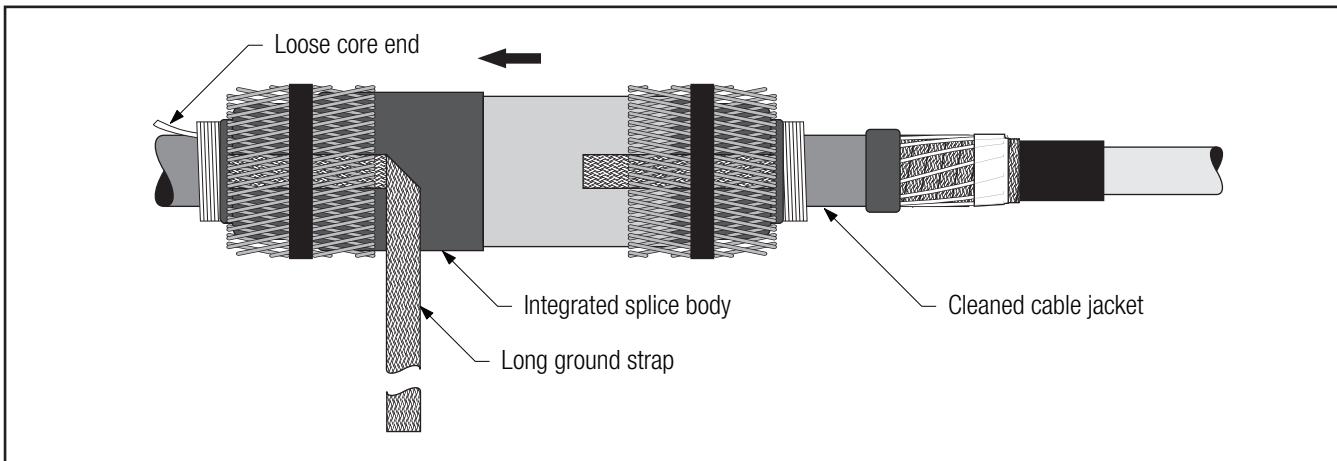


Figure 6

## 3.0 Install Connector

**Note:** *If using a crimp-type connector, go to step (3.3).*

- 3.1 **If using a 3M Shearbolt Connector QCI 1/0-350**, refer to the instructions included with the connector for insulation cut-back dimension. Insulation removal length shall not exceed 2 3/4" (70 mm) from conductor end (*Figure 7*).

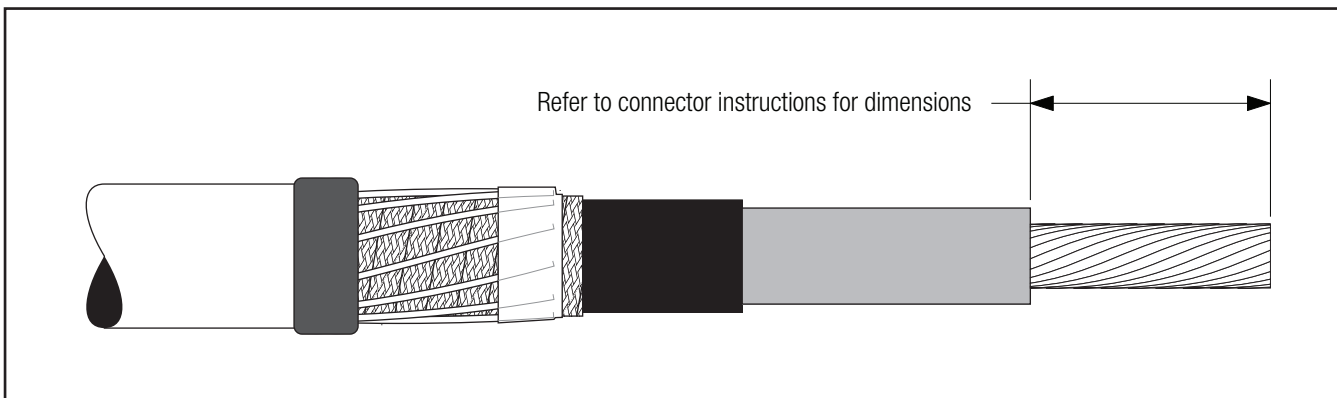


Figure 7

## 3M™ Cold Shrink QS4 Integrated Splice Kit QS4-35SP-1/0-350

- 3.2 Install 3M Shearbolt Connector QCI 1/0-350 according to the instructions included with the connector (Figure 8).

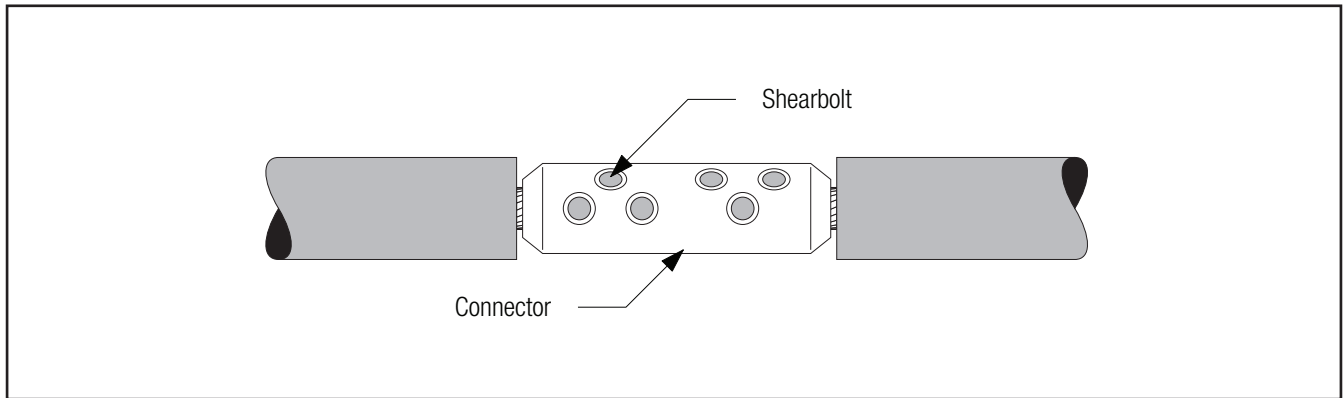


Figure 8

**Go to section 4.0 “Install Splice.”**

- 3.3 **If using a crimp type connector,** remove cable insulation for 1/2 connector length plus an allowance\* for increases in connector length due to crimping. Insulation removal length shall not exceed 3 1/4" (83 mm) from conductor end. **Do not install connector now** (Figure 9).

*\*Note: This assumes that the installer has determined the increased length of an aluminum connector crimped with a specific tool and die.*

### Aluminum (Al/Cu) Crimp Connector Growth Chart

Conductor Size	Typical growth allowance (per end)
1/0-3/0 AWG	1/8" (3 mm)
4/0 AWG -350 kcmil	1/4" (6 mm)

**Note:** 1) Copper connectors do not require a length change allowance.  
2) Maximum aluminum connector crimped length allowed is 6.50" (165 mm).

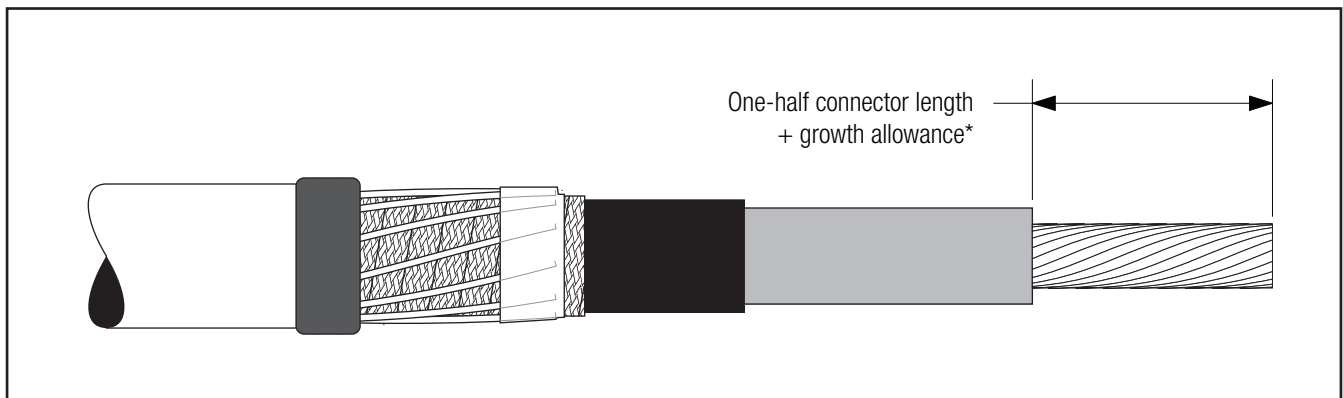


Figure 9

### 3M™ Cold Shrink QS4 Integrated Splice Kit QS4-35SP-1/0-350

- 3.4 For 1/0 through 3/0 AWG copper connectors, or connectors with an O.D. between 0.51–0.76" (13,0-19,3 mm): Park the cold shrink adapter tube with the **WHITE CORE** on the insulation.

For 4/0 AWG through 350 copper connectors or connectors with an O.D. between 0.68-1.07" (17,3-27,2 mm): Park the cold shrink adapter tube with the **RED CORE** on the insulation. (Figure 10).

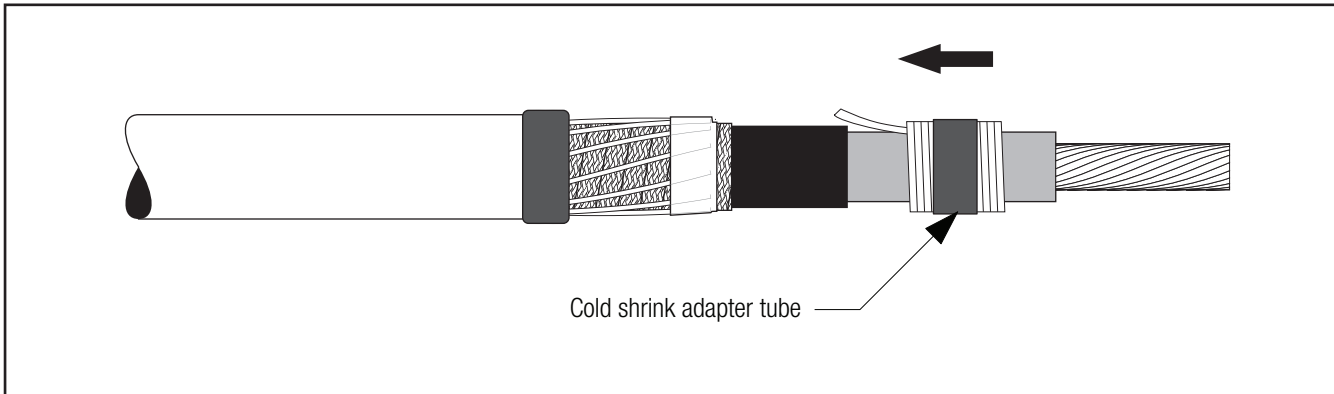


Figure 10

- 3.5 Install connector. See table (on cover) for proper connector dimensions. (For standard 3M Connectors, refer to table at the end of this instruction for crimping information). If using an aluminum conductor, wire brush aluminum strands and then insert into connector. Remove excess inhibitor compound and remove conductor from connector. Wire brush aluminum strands again. Insert into connector and crimp. Remove any excess oxidation inhibitor from connector ends (Figures 11 and 12). File sharp connector flashing, if necessary, taking care to remove all metal filings from splice area.

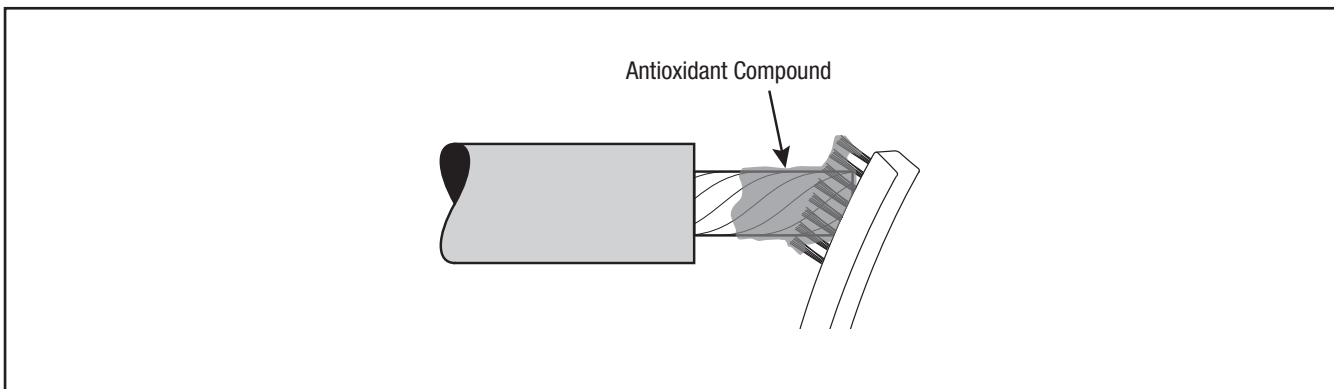


Figure 11

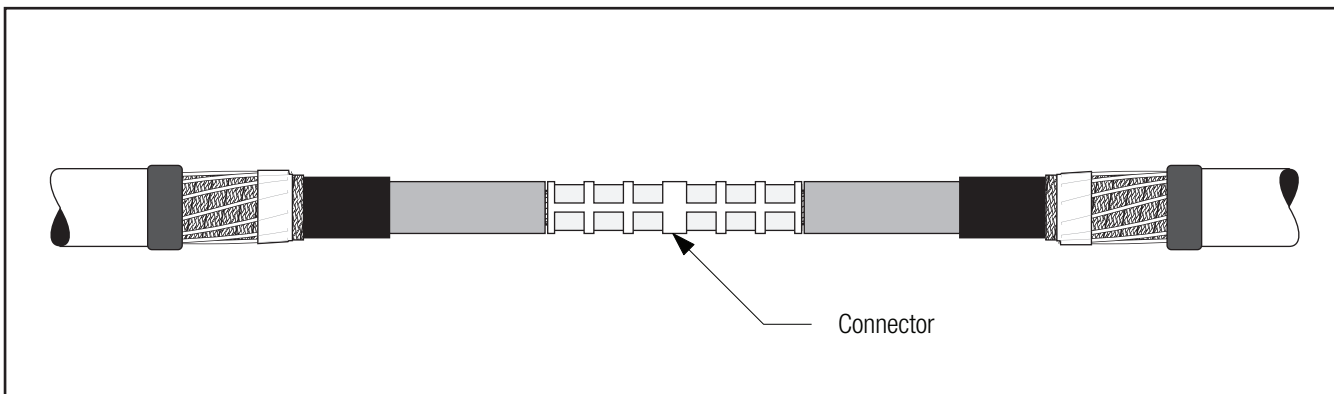


Figure 12



## 4.0 Install Splice

- 4.1 Apply a tape marker to semi-con insulation shield on cable which does not contain splice. Measure 10 1/2" (267 mm) from center of connector (*Figure 13*).

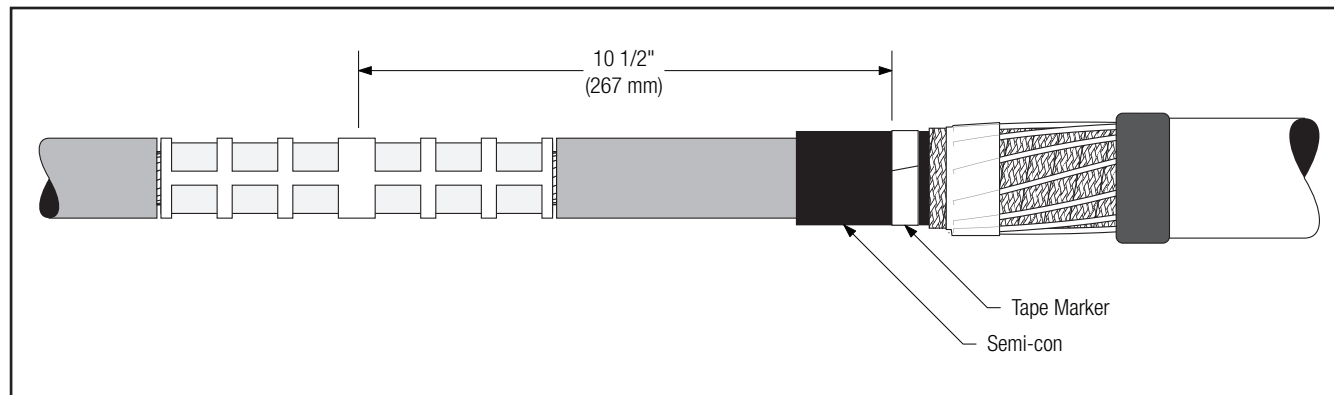


Figure 13

- 4.2 **If using cold shrink adapter tube:** Position adapter tube over the connector. Shrink adapter near the center of connector by pulling and unwinding the loose core end in a counter-clockwise direction (*Figure 14*).

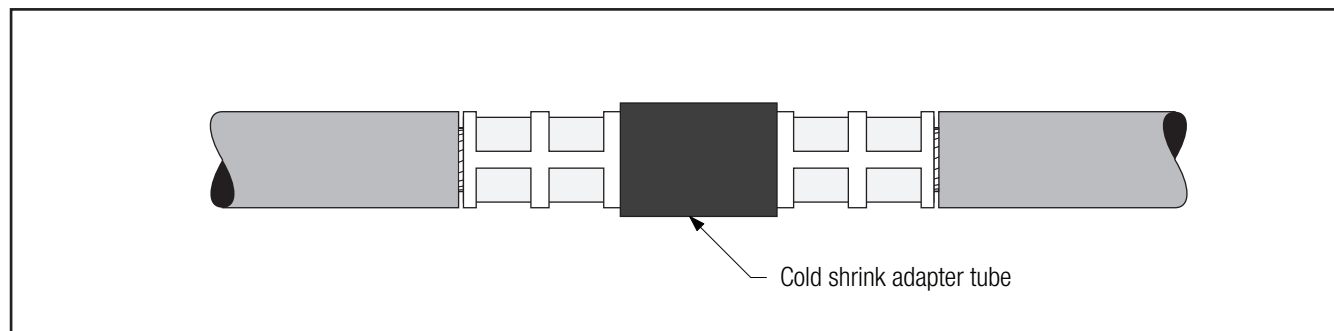


Figure 14

- 4.3 Clean cables using standard practice:
- Do not allow solvent or abrasive to contact the cable semi-conductive insulation shield.
  - Do not reduce cable insulation diameter below 1.07" (27,2 mm) specified for the splice.
  - The insulation surface must be round, smooth and free of cuts/voids. Sanding may be necessary, finish sanding should be done with a 120 grit or higher electrical grade abrasive.
  - Make certain that the cable insulation is smooth, clean and dry before continuing.

## 3M™ Cold Shrink QS4 Integrated Splice Kit QS4-35SP-1/0-350

- 4.4 Apply 3M Red Compound P55/R on cable insulations, making certain to fill in edge of cable semi-con. **Do not use silicone grease** (Figure 15).

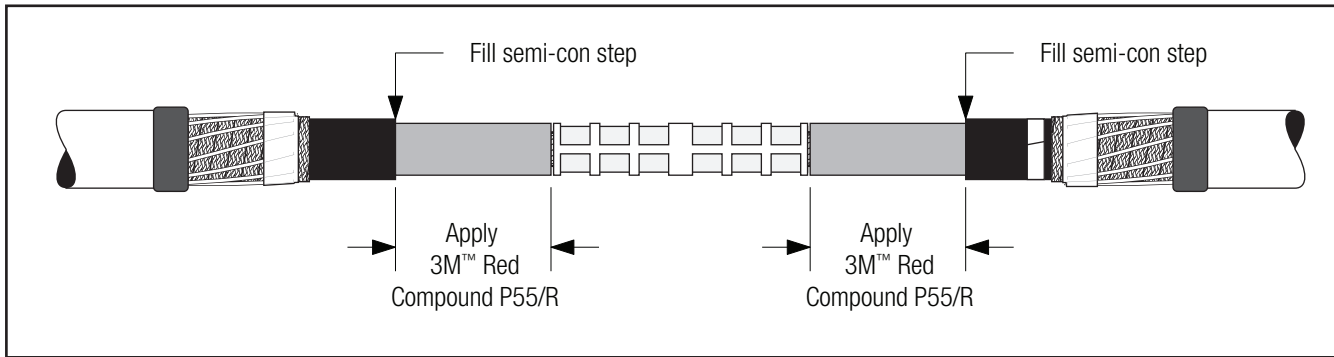


Figure 15

**Note:** *This core installs differently than other cold shrink products.*

- 4.5 Position the splice body over connector area, aligning end of the splice body (not the core) at the center of the tape marker. **Slowly** start to remove the splice core by pulling and unwinding the loose core end counterclockwise, allowing only 1/4" (6 mm) of the splice to shrink onto the tape marker. Carefully slide the splice body off the tape marker by pulling and twisting until the entire tape marker is exposed. Continue removing the core to complete the splice body installation (Figure 16).

**Note:** *The splice body ends must overlap onto the semi-con of each cable by at least 1/2" (13 mm).*

**Note:** *Do not push the splice body toward the tape marker as this may cause the end to roll under. If the end does roll under, DO NOT use sharp-edged tools to pull it out as this could cut and damage the splice.*

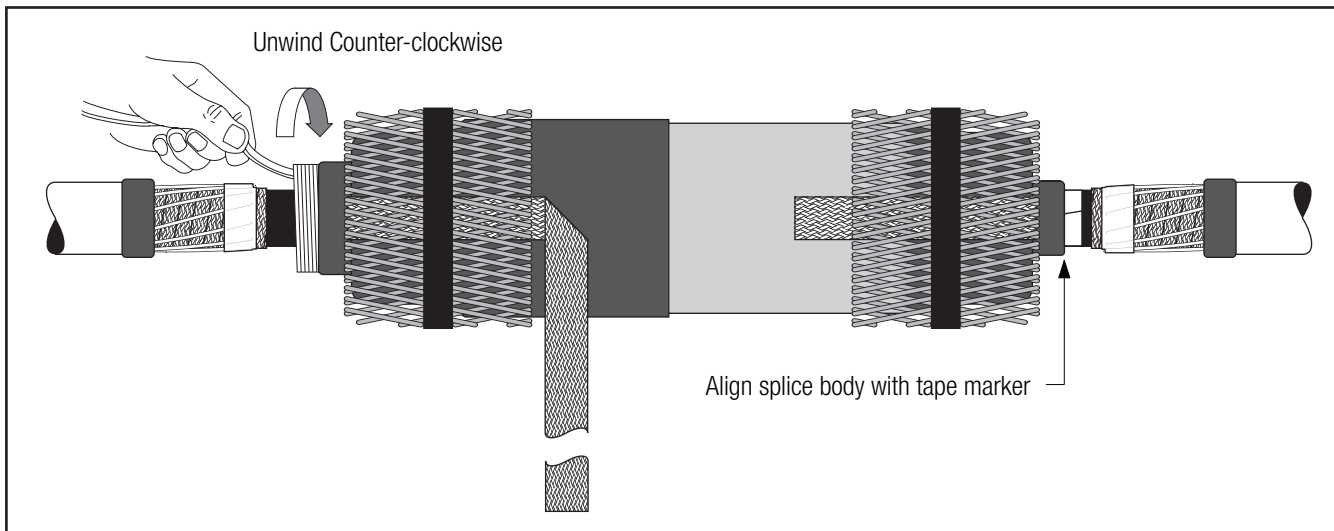


Figure 16

## 5.0 Connect Shielding

- 5.1 Remove the vinyl tape holding the shield sleeve on the re-jacketing tube, and spread the shield sleeve out toward the cable jacket.

**Note:** *If vinyl tape was used in Step 2.7 to temporarily secure the ends of the neutral wires, remove it and use the 3M Aluminium Foil Tape Strips 1115B to secure the ends of the neutral wires. Remove the liner from the aluminum tape. Wrap the tape on top of itself and tightly press down on the edges of the tape.*

**Note:** *The 3M Cold Shrink Integrated Splice Body includes a pre-installed ground braid for external grounding. If not using the ground braid to externally ground, it may be cut off and tied into the ground system with the shield sleeve, using constant force springs.*

### 3M™ Cold Shrink QS4 Integrated Splice Kit QS4-35SP-1/0-350

- 5.2 Hand-tighten the shield sleeve outward and secure it, along with the ground braid, to the neutral wires, tape or LC shields on either side of the splice using two constant force springs on each end between the vinyl tape at the jacket edge and the aluminum foil tape or copper foil tape as shown (*Figure 17*).
- 5.3 If shield sleeve extends beyond neutral wires, it may be interwoven with the constant force springs. Trim excess ground braid if needed. Cinch (tighten) the spring after wrapping the final winding (*Figure 17*).

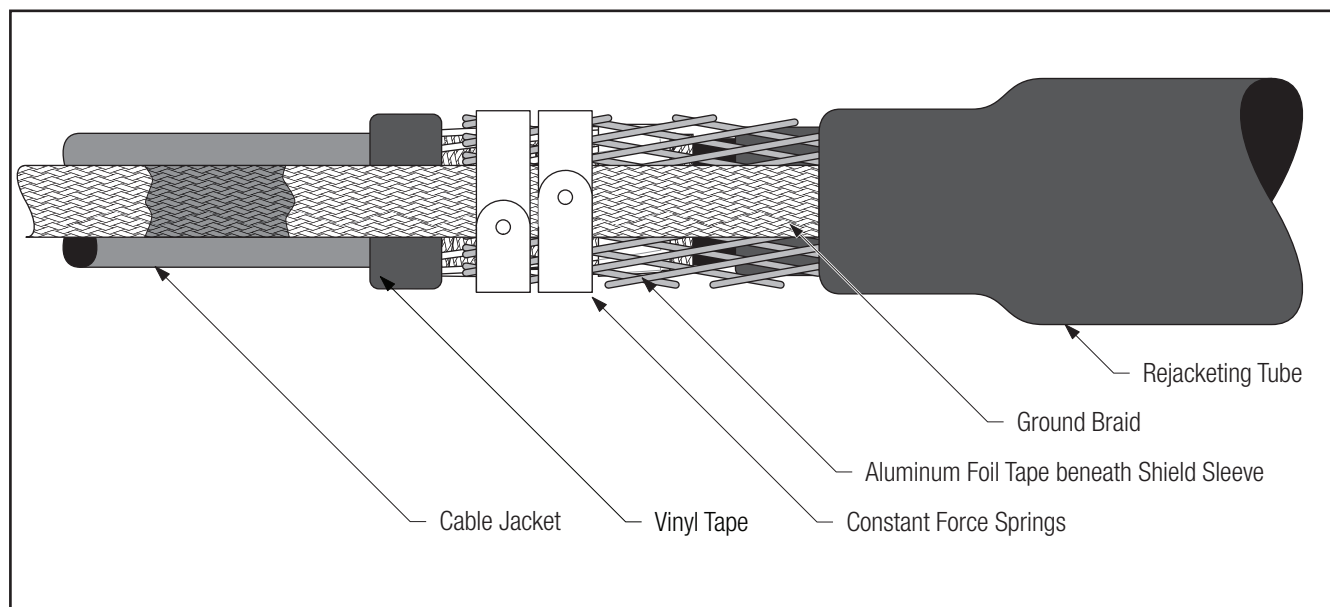


Figure 17

- 5.4 Place one mastic sealing strip on the cable jacket under the solder block of the ground strap no farther than 1/2" (13 mm) from the edge of the vinyl tape from the water block (*Figure 18*).

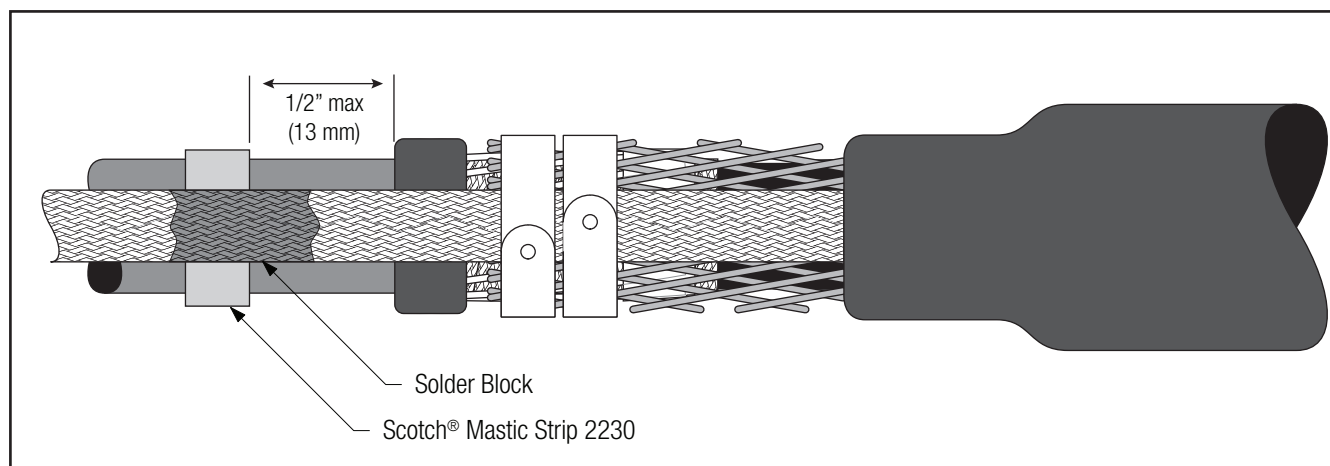


Figure 18

### 3M™ Cold Shrink QS4 Integrated Splice Kit QS4-35SP-1/0-350

- 5.5 Place another mastic strip over the solder block. Press the mastic strips around the solder block and to the cable jacket (*Figure 19*).

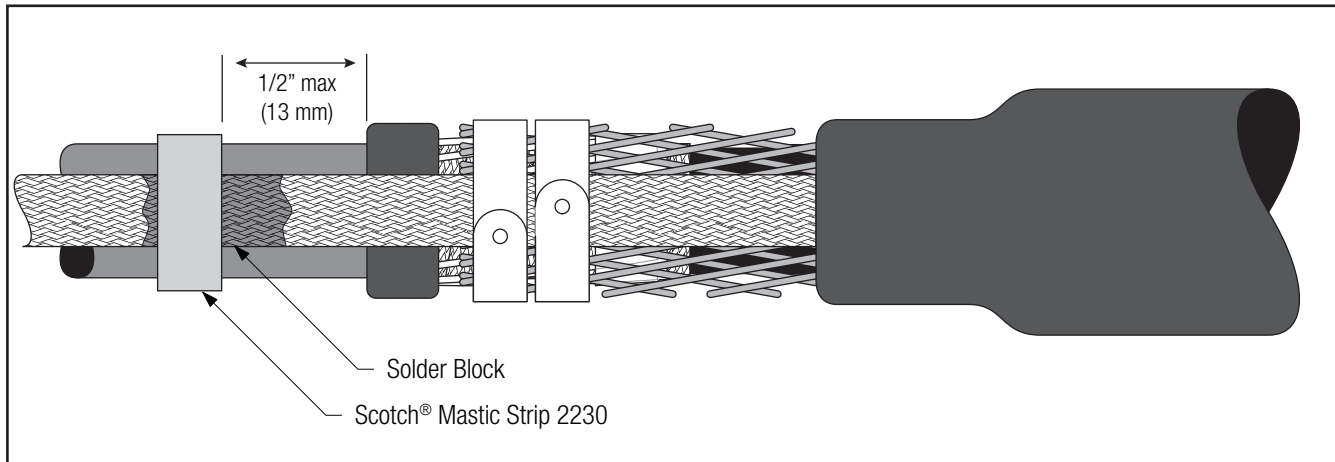


Figure 19

- 5.6 Wrap two half-lapped layers of vinyl tape over all constant force springs (*Figure 20*).

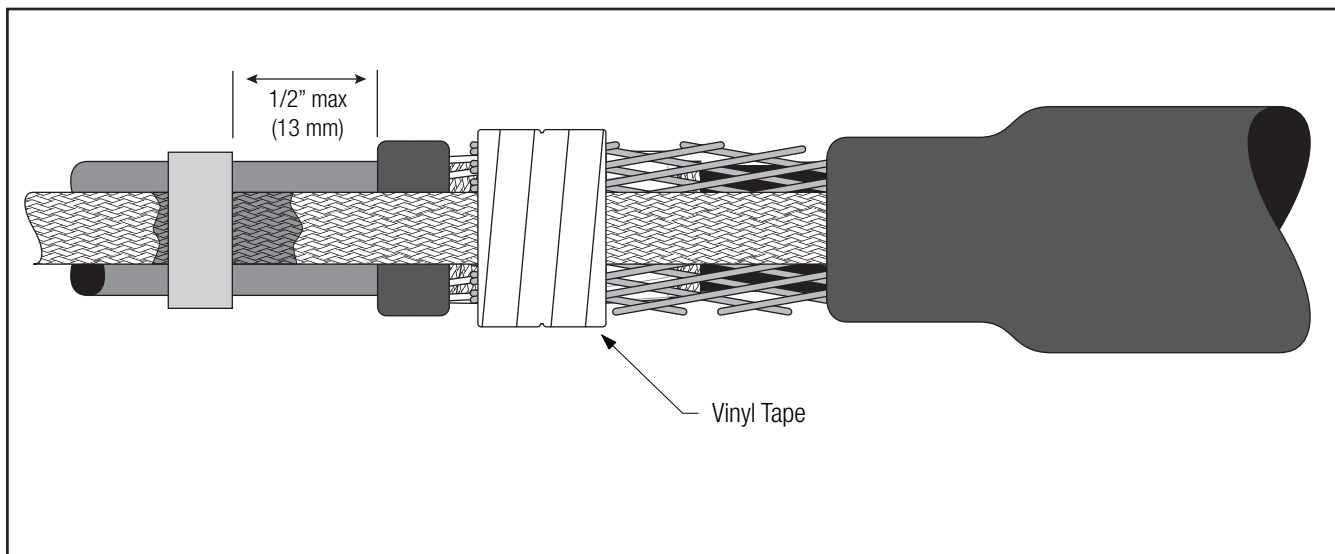


Figure 20

## 6.0 Install Jacket

**Note:** *Jacketing is not optional.*

- 6.1 Wrap a roll of slightly stretched Scotch® Rubber Mastic Tape 2228, 2" x 36" around cable jacket ends (tacky side toward cable) (*Figure 21*). If grounding was applied, apply tape over mastic strips at solder block. Stretch and tear off last 1–2" (25–50 mm) of mastic (*Figure 22*).

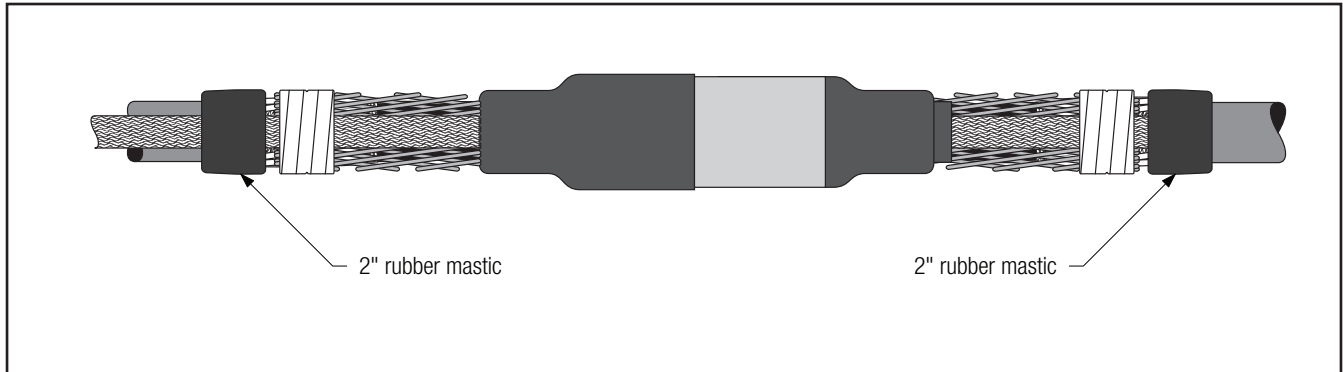


Figure 21

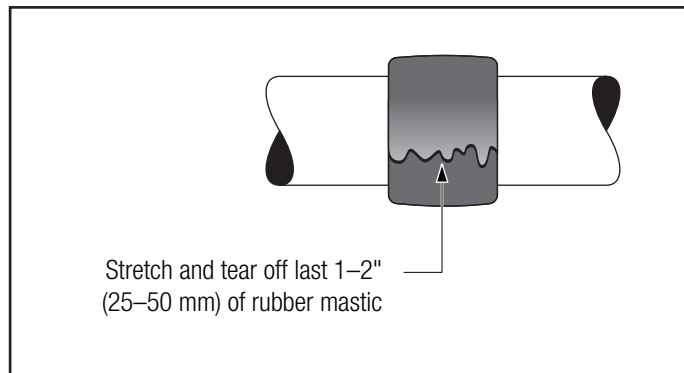


Figure 22

- 6.2 Install the rejacketing tube by twisting the tube (not the liner) from side to side to start the movement. Then slide and unroll the tube over the constant force springs and rubber mastic. (*Figure 23*). Repeat on other side.

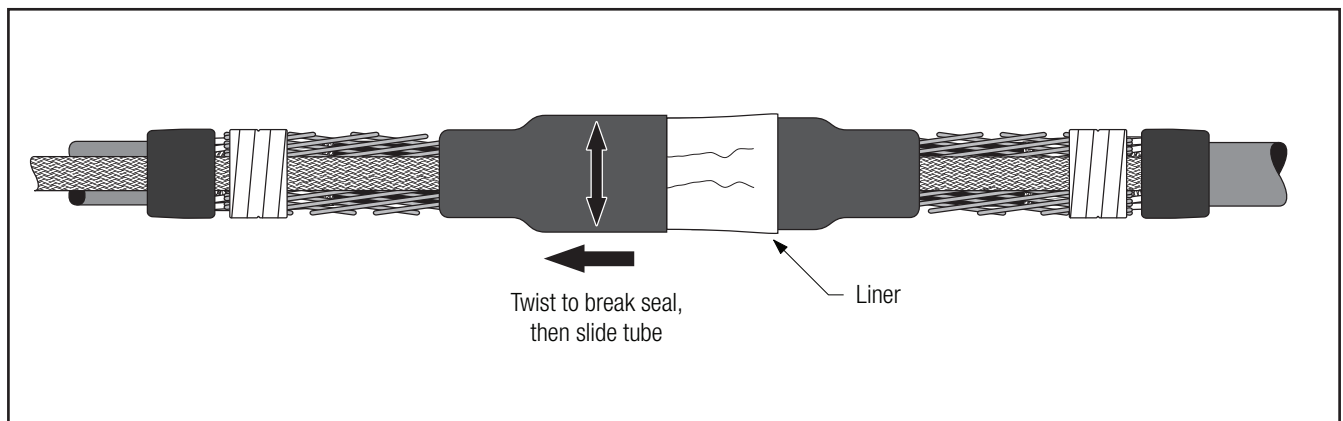


Figure 23

6.3 Remove the liners and discard.

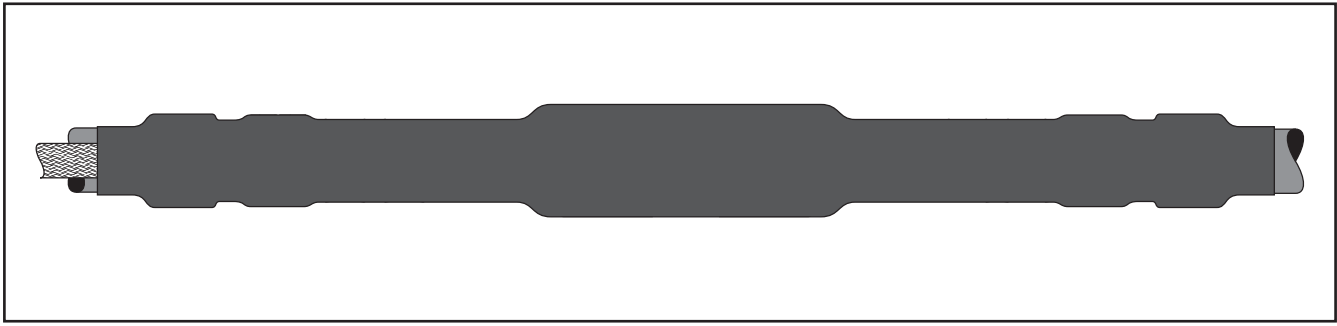


Figure 24

6.4 Connect optional grounding.

**Note:** *In applications where the splice is regularly exposed to high levels of ultra-violet radiation (i.e. direct sunlight), wrap two half-lapped layers of Scotch® Super 33+™ Vinyl Electrical Tape or Scotch® Vinyl Electrical Tape Super 88 over the re-jacketing tube.*

## Crimping Tool - Die Sets (number of crimps/end)

3M™ Connector Number	Conductor Size (kcmil)	Burndy						Thomas & Betts Corp.				Square D Co. Anderson Div.	Kearney
		MD6	MY29	Y34A	Y35, &39 Y45*, Y46*	Y1000**		TBM 5	TBM 8	TBM 12	TBM 15	VC6-3** VC6-FT**	Type 0
10005 (Cu)	1/0	W163(2)	1/0(1)	A25R(1)	U25RT(1)	---		Pink(2)	Pink(2)	---	42(2)	(1)	---
20005 (Al/Cu)	1/0	W241(2)	1/0(1)	A25AR(1)	U25ART(1)	(1)		Tan(2)	Tan(2)	---	50(1)	(1)	5/8-1 (3)
CI-1/0 (Al/Cu)	1/0	BG (3)	---	U243 (1)	U25ART(1)	---		---	Olive(2)	---	50(1)	(1)	5/8-1 (3)
10006 (Cu)	2/0	W241(2)	2/0(1)	A26R(1)	U26RT(2)	---		Black(2)	Black(2)	---	45(1)	(1)	---
20006 (Al/Cu)	2/0	BG(4)	2/0(1)	A26AR(2)	U26ART(2)	(1)		Olive(2)	Olive(2)	---	54H(2)	(2)	5/8-1 (3)
11006 (Cu)	2/0	W241(3)	2/0(2)	A26R(2)	U26RT(2)	---		Black(3)	Black(3)	---	45(2)	(2)	---
CI-2/0 (Al/Cu)	2/0	W249(3)	---	---	U28ART(2)	---		---	Blue(4)	---	76(2)	(2)	840 (4)
10007 (Cu)	3/0	W243(2)	3/0(1)	A27R(1)	U27RT(2)	---		Orange(2)	Orange(2)	---	50(1)	(1)	---
20007 (Al/Cu)	3/0	W166(4)	3/0(1)	---	U27ART(2)	(1)		Ruby(2)	Ruby(2)	---	60(2)	(2)	737 (3)
11007 (Cu)	3/0	W243(3)	3/0(2)	A27R(2)	U27RT(3)	---		Orange(3)	Orange(3)	---	50(2)	(2)	---
CI-3/0 (Al/Cu)	3/0	W249(3)	---	---	U28ART(2)	---		---	Blue(4)	---	76(2)	(2)	840 (4)
10008 (Cu)	4/0	BG(3)	4/0(1)	A28R(2)	U28RT(2)	---		Purple(2)	Purple(2)	---	54H(2)	(2)	---
20008 (Al/Cu)	4/0	W660(4)	4/0(2)	A26AR(2)	U28ART(2)	(1)		---	White(4)	---	66(4)	(2)	840 (4)
11008 (Cu)	4/0	BG(4)	4/0(2)	A28R(3)	U28RT(3)	---		Purple(3)	Purple(3)	---	54H(3)	(3)	---
CI-4/0 (Al/Cu)	4/0	W249(3)	---	---	U28ART(2)	---		---	Blue(4)	---	76(2)	(2)	840 (4)
10009 (Cu)	250	---	---	A29R (2)	U29RT(2)	---		Yellow (2)	Yellow (2)	---	62 (2)	(2)	---
20009 (Al/Cu)	250	---	---	A29AR (2)	U29ART(2)	(1)		---	---	71H(2)	71H(2)	(3)	---
11009 (Cu)	250	---	---	A29R (3)	U29RT(3)	---		Yellow (3)	Yellow (3)	---	62 (3)	(3)	---
CI-250 (Al/Cu)	250	---	---	---	U31ART(2)	---		---	---	87H(2)	87H(2)	(2)	---
10010 (Cu)	300	---	---	A30R (2)	U30RT(2)	---		---	White (2)	---	66(2)	(2)	---
20010 (Al/Cu)	300	---	---	A30AR (2)	U30ART(2)	(1)		---	---	76H(3)	76H(3)	(2)	---
11010 (Cu)	300	---	---	A30R (3)	U30RT(3)	---		---	White (3)	---	66(3)	(3)	---
CI-300 (Al/Cu)	300	---	---	---	U31ART(2)	---		---	---	87H(2)	87H(2)	(2)	---
10011 (Cu)	350	---	---	A31R (2)	U31RT(2)	---		---	Red (3)	---	71H(3)	(2)	---
20011 (Al/Cu)	350	---	---	---	U31ART(2)	(1)		---	---	87H(3)	87H(3)	(2)	---
11011 (Cu)	350	---	---	A31R (3)	U31RT(3)	---		---	Red (4)	---	71H(4)	(3)	---
CI-350 (Cu)	350	---	---	---	U31ART(2)	---		---	---	87H(2)	87H(2)	(3)	---

\*Y45 and Y46 accept all Y35 dies ("U Series"). For Y45, use PT6515 adapter. For Y46, use PUADP adapter.

\*\*Anderson VC6-3, VC6-FT, VC6C and Burndy Y1000 require no die set.

3M, Super 33+ and Scotch are trademarks of 3M Company.  
All other trademarks are the property of their respective owners.

#### **Important Notice**

All statements, technical information, and recommendations related to 3M's products are based on information believed to be reliable, but the accuracy or completeness is not guaranteed. Before using this product, you must evaluate it and determine if it is suitable for your intended application. You assume all risks and liability associated with such use. Any statements related to the product which are not contained in 3M's current publications, or any contrary statements contained on your purchase order shall have no force or effect unless expressly agreed upon, in writing, by an authorized officer of 3M.

#### **Warranty; Limited Remedy; Limited Liability.**

This product will be free from defects in material and manufacture at the time of purchase. **3M MAKES NO OTHER WARRANTIES INCLUDING, BUT NOT LIMITED TO, ANY IMPLIED WARRANTY OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE.** If this product is defective within the warranty period stated above, your exclusive remedy shall be, at 3M's option, to replace or repair the 3M product or refund the purchase price of the 3M product. **Except where prohibited by law, 3M will not be liable for any direct, indirect, special, incidental or consequential loss or damage arising from this 3M product, regardless of the legal theory asserted.**



#### **Electrical Markets Division**

6801 River Place Blvd.  
Austin, TX 78726-9000  
800.245.3573  
Fax 800.245.0329  
[www.3M.com/electrical](http://www.3M.com/electrical)

Please Recycle. Printed in USA.  
© 3M 2016. All Rights Reserved.  
78-8141-6311-5 Rev B